XNET / MER INTERFACE ENCLOSURE #1 – INTERNAL VIEW

DO NOT ENTER TOP OF CONTROL PANEL

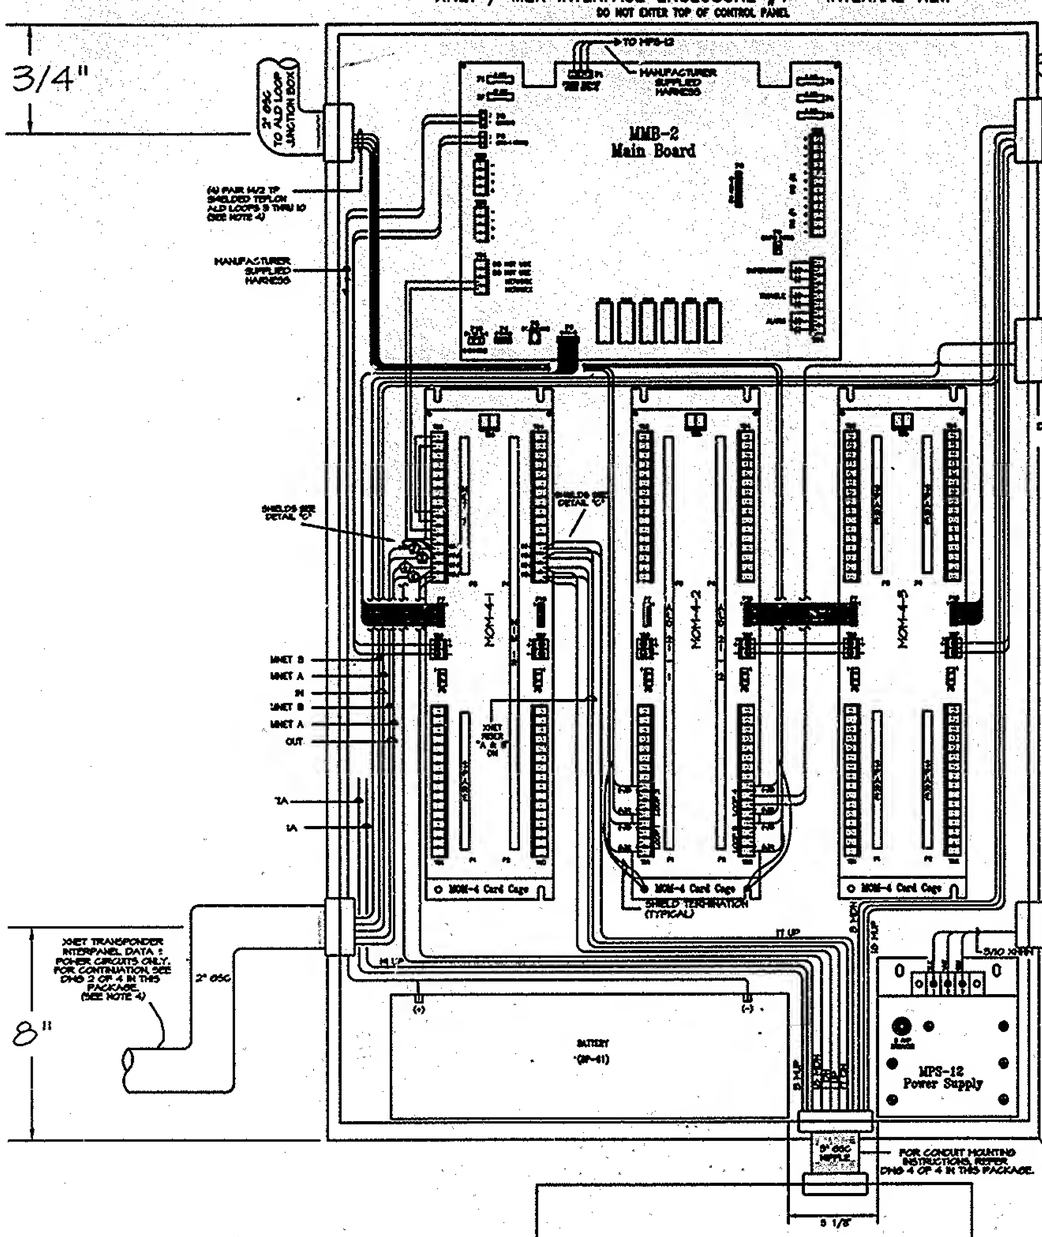

XNET / MER INTERFACE ENCLOSURE #2 – INTERNAL VIEW

DO NOT ENTER TOP OF CONTROL PANEL

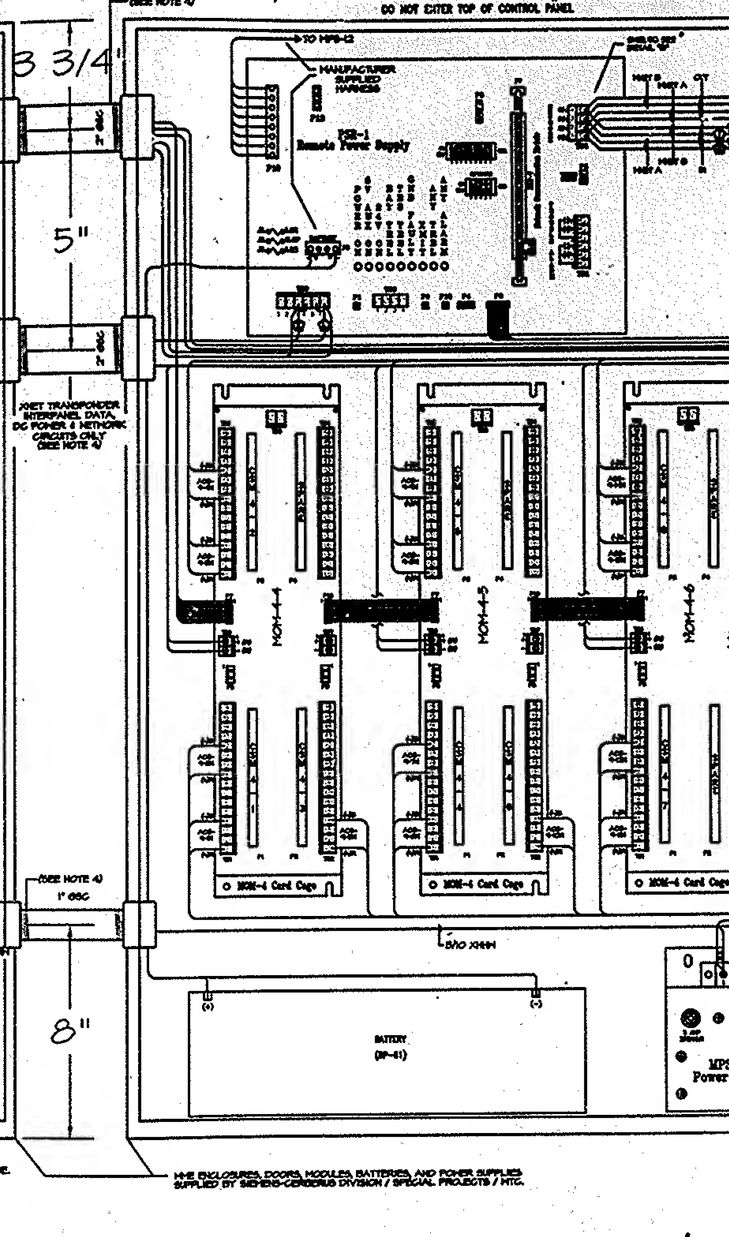

GENERIC	MFR'S	NOTES
	ALL MATERIALS UTILIZED SHALL BE APPROVED FOR USE BY THE ENGINEER. GROUNDING & BONDING REQUIRED - REFER TO P/A DRAWINGS. AC POWER WIRING SHALL BE #10 AWG (WHITE/NEUTRAL, BLACK/HOT, GREEN/GROUND) PER P/A SPECIFICATIONS & DRAWINGS. HIGH LEVEL AUDIO, SPEAKER, CONTROL & SOLENOID CIRCUITS SHALL BE UNSHIELDED TWISTED PAIR (UTP) TEFLON PER P/A SPECIFICATIONS & DRAWINGS. LOW LEVEL AUDIO NETWORK, ALD, SIPORT, TELEPHONE CIRCUITS SHALL BE SHIELDED TWISTED PAIR (STP) TEFLON PER P/A SPECIFICATIONS & DRAWINGS. ALL WIRING DEVICES, TERMINALS, CONNECTORS, ETC. SHALL BE UL LISTED FOR THE TYPE WIRE USED AND IN CONFORMANCE WITH P/A SPECIFICATIONS. #10 AWG #12 WIRES APPROVED SOLID WIRE TERMINAL FOR CONNECTION USE PANDUIT MODEL # PNO-10-10 TERMINAL & PANDUIT MODEL # GT-550 CONTROLLED CYCLE INSTALLATION TOOL.	ALL EQUIPMENT SHALL BE INSTALLED IN ACCORDANCE WITH SIEMENS-CERBERUS INSTALLATION INSTRUCTIONS, APPLICABLE CODES, & THE CONTRACT DOCUMENTS. DISCREPANCIES, CONFLICTS AND OMISSIONS FOUND IN ANY DOCUMENTS, DRAWINGS, SKETCHES, ETC., SHALL BE REPORTED IMMEDIATELY TO THE SIEMENS-CERBERUS DIVISION'S PROJECT MANAGER AND THE OWNER'S PROJECT ENGINEER. INSTALLING CONTRACTOR SHALL NOT PROCEED UNTIL CLARIFICATION AND RESOLUTION IS NOTED IN WRITING BY SIEMENS-CERBERUS DIVISION PROJECT MANAGER AND THE OWNER'S ENGINEER. ALL WORK SHALL BE FULLY PROTECTED AND SECURED BY A LICENSED SYSTEMS TECHNICIAN DESIGNATED BY THE SIEMENS-CERBERUS DIVISION'S DISTRICT MANAGER. SYSTEMS SHALL NOT BE ENERGIZED PRIOR TO INSPECTION. TERMINAL BLOCKS, FIELD WIRING CONNECTIONS AND CONNECTIONS TO EQUIPMENT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. ALL CONNECTIONS MADE DIRECTLY OR INDIRECTLY TO SIEMENS-CERBERUS EQUIPMENT SHALL BE APPROVED BY SIEMENS-CERBERUS DIVISION. ALL WORK SHALL BE IN ACCORDANCE WITH ALL SIEMENS-CERBERUS DIVISION STANDARDS, DETAILS AND SPECIFICATIONS. EQUIPMENT, DEVICES OR MATERIALS NOT LISTED AND APPROVED FOR USE WITH THIS EQUIPMENT BY SIEMENS-CERBERUS DIVISION SHALL NOT BE EMPLOYED. ALL CONNECTIONS ARE TO BE MADE AS CLOSE AS POSSIBLE TO THE BOARD AND IN THE ORDER AND MANNER AS SHOWN IN THE DRAWINGS. SEE DWG 4 OF 4 IN THIS PACKAGE FOR TERMINATION DETAILS.

FILE NAME: B:\DWG\ME-PLAS\X-POWER\Mn floor x-net specs and components\Mn power supply\Xn-mn3-1.dwg plotted on 3/3/1999 by hansen